







Test Report ITTSB.EU

Start Time: 2025-12-20 17:48:19

End Time: 2025-12-20 17:58:19

Total Time: 09:59

Sample Count: 600

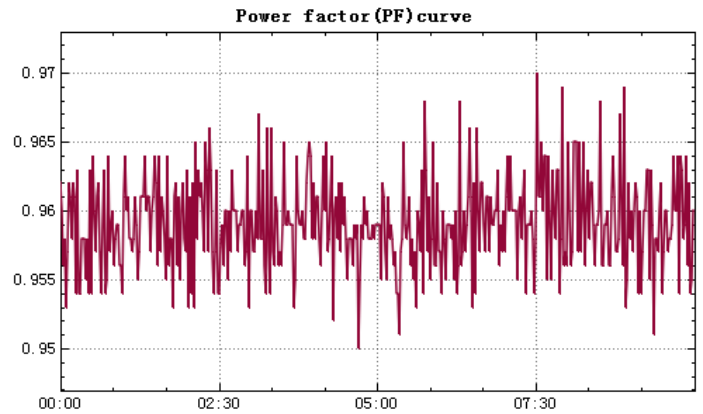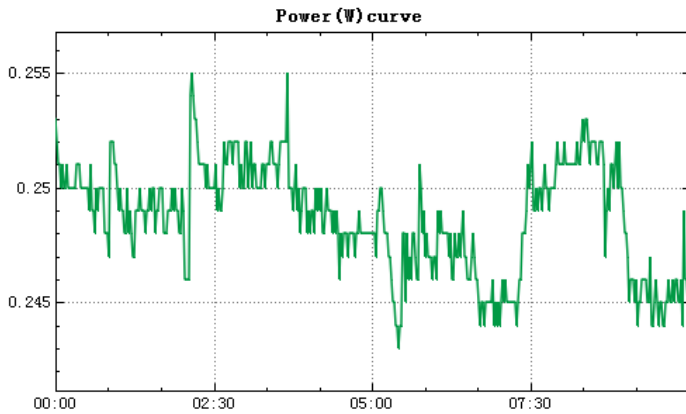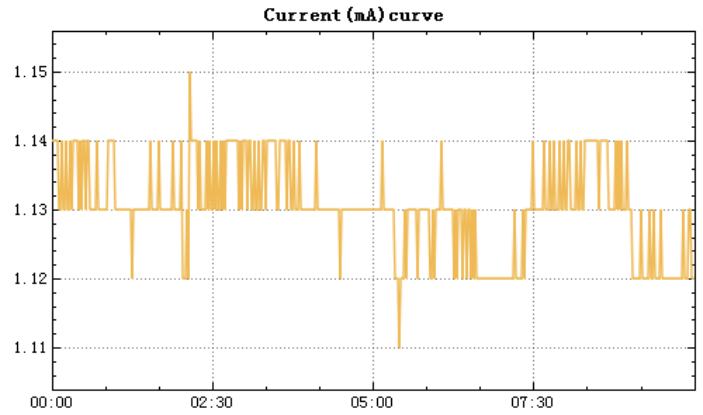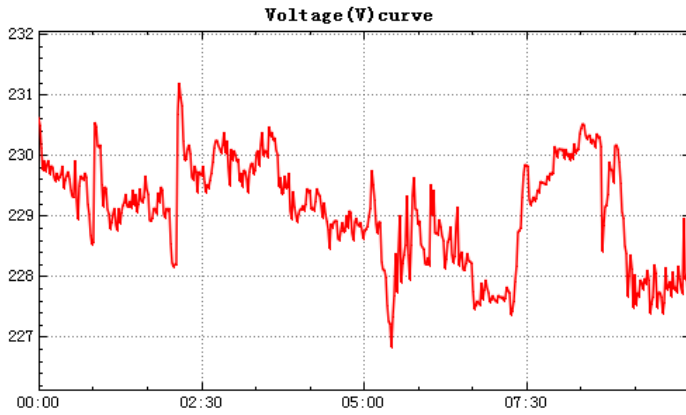

	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
Minimum	226.82	1.11	0.243	0.950	49.9
Maximum	231.38	1.15	0.255	0.970	50.2
Average	229.10	1.13	0.249	0.960	50.0

	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
1	00:00.176	230.61	1.14	0.253	0.962	50.1
2	00:01.182	230.50	1.14	0.253	0.962	50.1
3	00:02.173	230.26	1.14	0.252	0.960	50.0
4	00:03.179	230.12	1.14	0.251	0.956	50.0
5	00:04.186	229.75	1.14	0.251	0.958	50.0
6	00:05.176	229.91	1.14	0.250	0.953	50.1
7	00:06.183	229.72	1.13	0.251	0.966	50.0
8	00:07.173	229.88	1.14	0.251	0.957	50.0
9	00:08.180	229.84	1.13	0.250	0.962	50.0
10	00:09.171	229.91	1.14	0.252	0.961	50.0
11	00:10.178	229.73	1.13	0.250	0.963	50.0
12	00:11.184	229.68	1.14	0.251	0.958	50.0
13	00:12.175	229.83	1.13	0.250	0.962	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
14	00:13.181	229.80	1.14	0.252	0.961	50.0
15	00:14.171	229.64	1.13	0.250	0.963	50.0
16	00:15.178	229.66	1.14	0.250	0.954	50.0
17	00:16.184	229.57	1.13	0.250	0.963	50.0
18	00:17.175	229.70	1.14	0.250	0.954	50.0
19	00:18.182	229.58	1.13	0.250	0.963	50.0
20	00:19.172	229.69	1.14	0.250	0.954	50.1
21	00:20.179	229.64	1.14	0.251	0.958	50.0
22	00:21.169	229.69	1.14	0.251	0.958	50.0
23	00:22.176	229.82	1.14	0.251	0.958	50.0
24	00:23.182	229.72	1.14	0.251	0.958	50.0
25	00:24.173	229.45	1.14	0.250	0.955	50.0
26	00:25.179	229.58	1.13	0.250	0.963	50.0
27	00:26.171	229.66	1.14	0.251	0.958	50.1
28	00:27.177	229.73	1.14	0.250	0.954	50.0
29	00:28.183	229.62	1.13	0.250	0.963	50.0
30	00:29.174	229.68	1.14	0.250	0.954	50.0
31	00:30.180	229.43	1.14	0.250	0.955	50.0
32	00:31.171	229.31	1.13	0.250	0.964	50.0
33	00:32.177	229.30	1.13	0.249	0.960	50.0
34	00:33.184	229.94	1.14	0.252	0.961	50.0
35	00:34.174	229.91	1.14	0.251	0.957	50.0
36	00:35.181	229.27	1.13	0.249	0.961	50.1
37	00:36.171	228.94	1.13	0.249	0.962	50.0
38	00:37.177	229.17	1.13	0.248	0.957	50.0
39	00:38.168	229.50	1.13	0.250	0.964	50.0
40	00:39.174	229.65	1.14	0.250	0.954	50.0
41	00:40.181	229.62	1.13	0.249	0.959	50.0
42	00:41.171	229.59	1.13	0.250	0.963	50.0
43	00:42.178	229.66	1.14	0.250	0.954	50.1
44	00:43.168	229.70	1.13	0.250	0.963	50.0
45	00:44.176	229.63	1.14	0.250	0.955	50.0
46	00:45.182	229.42	1.13	0.250	0.964	50.0
47	00:46.173	229.19	1.13	0.248	0.957	50.0
48	00:47.179	229.03	1.13	0.249	0.962	50.0
49	00:48.170	228.69	1.13	0.248	0.959	50.0
50	00:49.176	228.52	1.13	0.248	0.960	50.0
51	00:50.183	228.57	1.13	0.247	0.956	50.0
52	00:51.173	229.02	1.13	0.250	0.966	50.0
53	00:52.180	230.55	1.14	0.252	0.958	50.0
54	00:53.170	230.46	1.14	0.252	0.959	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
55	00:54.177	230.38	1.14	0.252	0.959	50.0
56	00:55.167	230.15	1.14	0.252	0.960	50.0
57	00:56.173	230.12	1.14	0.251	0.956	50.0
58	00:57.180	230.17	1.14	0.251	0.956	50.0
59	00:58.170	229.75	1.14	0.250	0.954	50.0
60	00:59.177	229.51	1.13	0.250	0.963	50.0
61	01:00.167	229.15	1.13	0.249	0.961	50.0
62	01:01.175	229.47	1.13	0.250	0.964	50.0
63	01:02.181	229.45	1.13	0.249	0.960	50.0
64	01:03.172	229.30	1.13	0.250	0.964	50.0
65	01:04.178	229.09	1.13	0.249	0.961	50.0
66	01:05.169	229.03	1.13	0.248	0.958	50.0
67	01:06.175	228.77	1.13	0.249	0.963	50.0
68	01:07.166	228.88	1.13	0.248	0.958	50.0
69	01:08.172	229.10	1.14	0.250	0.957	50.0
70	01:09.179	229.02	1.13	0.248	0.958	50.0
71	01:10.169	229.12	1.13	0.249	0.961	50.0
72	01:11.176	229.09	1.13	0.249	0.961	50.0
73	01:12.166	228.85	1.13	0.248	0.959	50.0
74	01:13.173	228.75	1.13	0.247	0.955	50.0
75	01:14.163	229.12	1.13	0.248	0.957	50.0
76	01:15.170	228.86	1.12	0.247	0.963	50.0
77	01:16.176	229.06	1.13	0.249	0.961	50.0
78	01:17.167	229.27	1.13	0.249	0.961	50.0
79	01:18.173	229.18	1.13	0.249	0.961	50.0
80	01:19.165	229.21	1.13	0.249	0.961	50.0
81	01:20.171	229.36	1.13	0.250	0.964	50.0
82	01:21.178	229.44	1.13	0.249	0.960	50.1
83	01:22.168	229.15	1.13	0.249	0.961	50.0
84	01:23.174	229.14	1.13	0.249	0.961	50.0
85	01:24.165	229.24	1.13	0.249	0.961	50.0
86	01:25.171	229.16	1.13	0.248	0.957	50.0
87	01:26.178	229.12	1.13	0.249	0.961	50.0
88	01:27.168	229.43	1.13	0.249	0.960	50.0
89	01:28.175	229.16	1.13	0.249	0.961	50.0
90	01:29.165	229.43	1.13	0.250	0.964	50.0
91	01:30.172	229.35	1.13	0.250	0.964	50.0
92	01:31.162	229.05	1.13	0.249	0.962	50.0
93	01:32.169	229.19	1.14	0.250	0.956	50.0
94	01:33.175	229.44	1.13	0.250	0.964	50.0
95	01:34.166	229.61	1.13	0.249	0.959	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
96	01:35.172	229.23	1.13	0.248	0.957	50.0
97	01:36.164	229.21	1.13	0.249	0.961	50.0
98	01:37.170	229.30	1.13	0.249	0.960	50.0
99	01:38.177	229.69	1.13	0.250	0.963	50.0
100	01:39.167	229.66	1.14	0.251	0.958	50.0
101	01:40.173	229.43	1.14	0.250	0.955	50.0
102	01:41.164	229.35	1.13	0.250	0.964	50.0
103	01:42.171	229.35	1.14	0.250	0.956	50.0
104	01:43.161	228.91	1.13	0.248	0.958	50.0
105	01:44.167	228.91	1.13	0.248	0.958	50.1
106	01:45.174	228.96	1.13	0.248	0.958	50.0
107	01:46.164	229.12	1.14	0.249	0.953	50.0
108	01:47.171	229.36	1.13	0.250	0.964	50.0
109	01:48.161	229.09	1.13	0.249	0.961	50.0
110	01:49.168	229.03	1.13	0.249	0.962	50.0
111	01:50.158	229.38	1.14	0.250	0.956	50.0
112	01:51.165	229.21	1.13	0.250	0.965	50.1
113	01:52.171	229.23	1.13	0.249	0.961	50.0
114	01:53.162	229.48	1.14	0.250	0.955	50.1
115	01:54.169	229.43	1.13	0.249	0.960	50.0
116	01:55.175	229.09	1.13	0.249	0.961	50.0
117	01:56.166	229.02	1.13	0.249	0.962	50.0
118	01:57.173	228.96	1.13	0.248	0.958	50.0
119	01:58.163	229.13	1.13	0.248	0.957	50.0
120	01:59.170	229.07	1.13	0.248	0.958	50.0
121	02:00.160	229.57	1.13	0.250	0.963	50.0
122	02:01.166	229.12	1.14	0.249	0.953	50.0
123	02:02.173	228.54	1.12	0.246	0.961	50.0
124	02:03.163	228.21	1.12	0.246	0.962	50.0
125	02:04.170	228.15	1.13	0.246	0.954	50.0
126	02:05.160	228.17	1.12	0.246	0.962	50.0
127	02:06.167	228.20	1.13	0.246	0.953	50.0
128	02:07.157	228.20	1.12	0.246	0.962	50.0
129	02:08.163	230.68	1.14	0.254	0.965	50.0
130	02:09.169	231.38	1.15	0.255	0.958	50.0
131	02:10.161	231.20	1.14	0.254	0.963	50.0
132	02:11.168	230.95	1.14	0.254	0.964	50.0
133	02:12.159	230.82	1.14	0.253	0.961	50.1
134	02:13.165	230.66	1.14	0.253	0.962	50.0
135	02:14.172	230.24	1.14	0.252	0.960	50.0
136	02:15.562	229.91	1.14	0.251	0.957	50.1



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
137	02:16.169	229.94	1.14	0.251	0.957	50.0
138	02:17.159	230.09	1.13	0.251	0.965	50.0
139	02:18.166	230.24	1.14	0.253	0.963	50.0
140	02:19.156	230.18	1.13	0.251	0.965	50.0
141	02:20.162	230.04	1.14	0.251	0.957	50.0
142	02:21.169	229.86	1.13	0.251	0.966	50.0
143	02:22.160	229.64	1.13	0.250	0.963	50.1
144	02:23.166	229.58	1.13	0.250	0.963	50.0
145	02:24.157	229.83	1.14	0.251	0.957	50.0
146	02:25.163	229.72	1.14	0.250	0.954	50.0
147	02:26.170	229.39	1.13	0.250	0.964	50.0
148	02:27.160	229.89	1.14	0.251	0.957	50.0
149	02:28.167	229.73	1.13	0.250	0.963	50.0
150	02:29.158	229.67	1.14	0.250	0.954	50.0
151	02:30.164	229.66	1.13	0.250	0.963	50.0
152	02:31.155	229.66	1.14	0.250	0.954	50.1
153	02:32.161	229.82	1.14	0.251	0.958	50.1
154	02:33.168	229.56	1.13	0.249	0.959	50.0
155	02:34.158	229.37	1.14	0.250	0.956	50.0
156	02:35.165	229.44	1.13	0.250	0.964	50.0
157	02:36.155	229.52	1.13	0.249	0.960	50.0
158	02:37.162	229.45	1.13	0.249	0.960	50.0
159	02:38.168	229.58	1.14	0.250	0.955	50.0
160	02:39.159	229.70	1.13	0.250	0.963	50.0
161	02:40.165	230.24	1.14	0.252	0.960	50.0
162	02:41.156	229.89	1.14	0.251	0.957	50.0
163	02:42.162	230.13	1.13	0.251	0.965	50.0
164	02:43.169	230.45	1.14	0.253	0.963	50.0
165	02:44.159	230.24	1.14	0.252	0.960	50.0
166	02:45.166	230.24	1.14	0.252	0.960	50.0
167	02:46.157	230.14	1.14	0.252	0.960	50.0
168	02:47.164	230.09	1.14	0.252	0.960	50.0
169	02:48.154	230.04	1.14	0.251	0.957	50.0
170	02:49.160	230.30	1.14	0.252	0.959	50.0
171	02:50.167	230.17	1.14	0.252	0.960	50.0
172	02:51.157	230.37	1.14	0.252	0.959	50.0
173	02:52.164	230.25	1.14	0.252	0.960	50.0
174	02:53.154	230.04	1.14	0.252	0.960	50.0
175	02:54.161	230.24	1.14	0.251	0.956	50.0
176	02:55.167	229.79	1.13	0.250	0.962	50.0
177	02:56.158	230.00	1.14	0.251	0.957	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
178	02:57.164	229.50	1.13	0.250	0.964	50.0
179	02:58.155	230.10	1.14	0.252	0.960	50.0
180	02:59.161	229.91	1.14	0.250	0.953	50.0
181	03:00.152	230.08	1.14	0.252	0.960	50.0
182	03:01.158	230.24	1.14	0.252	0.960	50.0
183	03:02.165	230.00	1.14	0.251	0.957	50.0
184	03:03.155	229.90	1.13	0.250	0.962	50.0
185	03:04.163	229.93	1.14	0.251	0.957	50.0
186	03:05.153	230.07	1.14	0.252	0.960	50.0
187	03:06.160	229.57	1.13	0.250	0.963	50.0
188	03:07.166	229.70	1.14	0.251	0.958	50.0
189	03:08.157	229.48	1.13	0.251	0.967	50.0
190	03:09.163	229.74	1.14	0.251	0.958	50.0
191	03:10.153	229.78	1.14	0.251	0.958	50.0
192	03:11.160	229.72	1.13	0.250	0.963	50.0
193	03:12.150	229.60	1.13	0.250	0.963	50.0
194	03:13.157	229.39	1.14	0.250	0.956	50.0
195	03:14.163	229.72	1.14	0.250	0.954	50.0
196	03:15.154	229.86	1.13	0.251	0.966	50.0
197	03:16.160	229.85	1.13	0.251	0.966	50.1
198	03:17.151	229.87	1.14	0.251	0.957	50.0
199	03:18.157	229.69	1.14	0.250	0.954	50.0
200	03:19.164	229.79	1.14	0.251	0.958	50.0
201	03:20.154	229.76	1.13	0.251	0.966	50.0
202	03:21.162	230.04	1.14	0.251	0.957	50.0
203	03:22.152	230.08	1.14	0.251	0.956	50.0
204	03:23.159	230.41	1.14	0.253	0.963	50.0
205	03:24.149	229.83	1.14	0.252	0.961	50.1
206	03:25.156	230.18	1.14	0.252	0.960	50.0
207	03:26.162	230.39	1.14	0.252	0.959	50.0
208	03:27.153	230.16	1.14	0.251	0.956	50.0
209	03:28.159	229.99	1.14	0.251	0.957	50.0
210	03:29.150	230.07	1.14	0.251	0.956	50.0
211	03:30.156	230.06	1.13	0.250	0.961	50.0
212	03:31.163	230.40	1.14	0.252	0.959	50.0
213	03:32.153	229.97	1.13	0.251	0.965	50.0
214	03:33.160	230.47	1.14	0.252	0.959	50.0
215	03:34.150	230.31	1.14	0.252	0.959	50.0
216	03:35.156	230.37	1.14	0.252	0.959	50.1
217	03:36.147	230.23	1.14	0.252	0.960	50.1
218	03:37.154	230.27	1.14	0.252	0.959	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
219	03:38.161	230.28	1.14	0.252	0.959	50.1
220	03:39.152	230.08	1.13	0.252	0.969	50.0
221	03:40.158	231.13	1.15	0.255	0.959	50.0
222	03:41.149	230.01	1.14	0.250	0.953	50.0
223	03:42.155	229.47	1.14	0.250	0.955	50.0
224	03:43.162	229.63	1.14	0.250	0.955	50.0
225	03:44.152	229.48	1.13	0.250	0.964	50.0
226	03:45.158	229.36	1.13	0.249	0.960	50.0
227	03:46.149	229.39	1.14	0.251	0.959	50.0
228	03:47.155	229.65	1.13	0.250	0.963	50.0
229	03:48.146	229.46	1.14	0.251	0.959	50.0
230	03:49.153	229.48	1.13	0.249	0.960	50.0
231	03:50.159	229.50	1.13	0.250	0.964	50.0
232	03:51.149	229.70	1.14	0.251	0.958	50.0
233	03:52.156	229.08	1.13	0.248	0.958	50.0
234	03:53.147	228.94	1.13	0.249	0.962	50.0
235	03:54.153	229.47	1.13	0.250	0.964	50.0
236	03:55.159	229.41	1.13	0.250	0.964	50.0
237	03:56.151	229.15	1.13	0.250	0.965	50.0
238	03:57.157	229.36	1.13	0.250	0.964	50.0
239	03:58.147	229.00	1.13	0.249	0.962	50.0
240	03:59.154	228.88	1.13	0.248	0.958	50.1
241	04:00.144	229.02	1.13	0.249	0.962	50.0
242	04:01.151	229.09	1.13	0.248	0.958	50.0
243	04:02.157	229.48	1.13	0.250	0.964	50.0
244	04:03.148	229.09	1.13	0.249	0.961	50.0
245	04:04.154	229.18	1.13	0.249	0.961	50.0
246	04:05.145	229.08	1.13	0.248	0.958	50.0
247	04:06.152	229.19	1.13	0.250	0.965	50.0
248	04:07.158	229.34	1.14	0.250	0.956	50.0
249	04:08.148	229.46	1.13	0.249	0.960	50.0
250	04:09.155	229.39	1.13	0.250	0.964	50.0
251	04:10.146	229.42	1.13	0.249	0.960	50.0
252	04:11.152	229.16	1.13	0.249	0.961	50.0
253	04:12.158	229.10	1.13	0.250	0.965	50.0
254	04:13.148	229.13	1.13	0.248	0.957	50.0
255	04:14.156	229.08	1.13	0.248	0.958	50.0
256	04:15.146	229.29	1.13	0.249	0.961	50.0
257	04:16.153	229.25	1.13	0.249	0.961	50.0
258	04:17.142	229.44	1.13	0.250	0.964	50.0
259	04:18.149	229.35	1.14	0.249	0.952	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
260	04:19.156	229.34	1.13	0.249	0.960	50.0
261	04:20.147	229.41	1.13	0.250	0.964	50.0
262	04:21.153	229.17	1.13	0.249	0.961	50.0
263	04:22.144	228.97	1.13	0.248	0.958	50.0
264	04:23.150	229.22	1.13	0.250	0.965	50.1
265	04:24.157	229.03	1.13	0.249	0.962	50.1
266	04:25.148	229.15	1.13	0.248	0.957	50.0
267	04:26.154	228.91	1.13	0.249	0.962	50.0
268	04:27.145	228.77	1.13	0.248	0.959	50.1
269	04:28.152	228.54	1.13	0.248	0.960	50.1
270	04:29.142	228.45	1.12	0.246	0.961	50.0
271	04:30.149	228.86	1.13	0.248	0.958	50.0
272	04:31.156	228.80	1.13	0.247	0.955	50.1
273	04:32.146	228.96	1.13	0.248	0.958	50.0
274	04:33.153	228.88	1.13	0.248	0.958	50.0
275	04:34.143	228.91	1.13	0.248	0.958	50.0
276	04:35.149	228.92	1.13	0.248	0.958	50.1
277	04:36.156	228.61	1.13	0.248	0.960	50.0
278	04:37.146	228.59	1.13	0.247	0.956	50.0
279	04:38.153	228.62	1.13	0.248	0.959	50.0
280	04:39.143	228.76	1.13	0.248	0.959	50.0
281	04:40.150	228.88	1.13	0.248	0.958	50.0
282	04:41.141	228.72	1.13	0.248	0.959	50.0
283	04:42.147	228.92	1.14	0.248	0.950	50.0
284	04:43.153	228.74	1.13	0.247	0.955	50.0
285	04:44.143	229.00	1.13	0.248	0.958	50.0
286	04:45.151	228.80	1.13	0.248	0.959	50.0
287	04:46.140	229.07	1.13	0.248	0.958	50.0
288	04:47.148	229.19	1.13	0.249	0.961	50.0
289	04:48.155	229.06	1.13	0.249	0.961	50.0
290	04:49.145	228.71	1.13	0.248	0.959	50.0
291	04:50.151	228.59	1.13	0.248	0.960	50.0
292	04:51.142	228.64	1.13	0.248	0.959	50.0
293	04:52.148	228.89	1.13	0.248	0.958	50.0
294	04:53.139	228.97	1.13	0.248	0.958	50.0
295	04:54.145	228.89	1.13	0.248	0.958	50.0
296	04:55.152	228.84	1.13	0.248	0.959	50.0
297	04:56.143	228.82	1.13	0.248	0.959	50.0
298	04:57.149	228.89	1.13	0.248	0.958	50.0
299	04:58.139	228.76	1.13	0.248	0.959	50.0
300	04:59.146	228.73	1.13	0.248	0.959	50.1



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
301	05:00.153	228.61	1.13	0.248	0.960	50.0
302	05:01.143	228.74	1.13	0.248	0.959	50.0
303	05:02.149	228.77	1.13	0.248	0.959	50.0
304	05:03.141	228.81	1.13	0.247	0.955	50.0
305	05:04.147	228.95	1.13	0.248	0.958	50.0
306	05:05.137	228.99	1.13	0.249	0.962	50.1
307	05:06.145	229.12	1.13	0.249	0.961	50.0
308	05:07.151	229.99	1.14	0.251	0.957	50.1
309	05:08.142	229.74	1.13	0.250	0.962	50.0
310	05:09.148	229.51	1.14	0.250	0.955	50.1
311	05:10.138	229.27	1.13	0.249	0.961	50.0
312	05:11.145	228.86	1.13	0.248	0.958	50.1
313	05:12.151	228.92	1.13	0.248	0.958	50.1
314	05:13.142	228.71	1.13	0.248	0.959	50.0
315	05:14.148	228.88	1.13	0.248	0.958	50.0
316	05:15.139	228.89	1.13	0.249	0.962	50.1
317	05:16.146	228.58	1.13	0.247	0.956	50.1
318	05:17.152	228.23	1.13	0.247	0.957	50.0
319	05:18.142	228.11	1.13	0.246	0.954	50.0
320	05:19.149	228.11	1.13	0.246	0.954	50.0
321	05:20.139	227.99	1.12	0.245	0.959	50.0
322	05:21.146	227.94	1.13	0.245	0.951	50.0
323	05:22.136	227.52	1.12	0.244	0.957	50.1
324	05:23.144	227.25	1.12	0.244	0.958	50.0
325	05:24.151	227.21	1.12	0.244	0.958	50.0
326	05:25.142	226.82	1.11	0.243	0.965	50.0
327	05:26.147	227.01	1.12	0.244	0.959	50.0
328	05:27.138	227.34	1.12	0.244	0.958	50.1
329	05:28.144	227.69	1.12	0.246	0.964	50.1
330	05:29.151	228.73	1.13	0.248	0.959	50.1
331	05:30.141	228.37	1.13	0.248	0.961	50.0
332	05:31.148	227.72	1.12	0.245	0.960	50.0
333	05:32.138	228.43	1.13	0.247	0.956	50.1
334	05:33.145	229.00	1.13	0.248	0.958	50.0
335	05:34.135	227.90	1.13	0.246	0.955	50.0
336	05:35.142	228.59	1.13	0.248	0.960	50.0
337	05:36.148	228.22	1.13	0.247	0.957	50.1
338	05:37.139	228.36	1.13	0.246	0.953	50.1
339	05:38.146	228.51	1.13	0.248	0.960	50.0
340	05:39.136	228.69	1.13	0.248	0.959	50.0
341	05:40.142	229.33	1.13	0.250	0.964	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
342	05:41.134	228.36	1.13	0.247	0.957	50.1
343	05:42.140	227.93	1.12	0.246	0.963	50.0
344	05:43.147	227.97	1.13	0.246	0.954	50.0
345	05:44.138	228.51	1.13	0.248	0.960	50.0
346	05:45.144	229.34	1.13	0.251	0.968	50.0
347	05:46.134	229.63	1.13	0.250	0.963	50.0
348	05:47.141	229.11	1.13	0.248	0.957	50.0
349	05:48.147	229.64	1.13	0.250	0.963	50.0
350	05:49.138	229.10	1.13	0.249	0.961	50.1
351	05:50.144	228.84	1.13	0.247	0.955	50.0
352	05:51.135	228.91	1.13	0.249	0.962	50.0
353	05:52.141	229.01	1.13	0.248	0.958	50.0
354	05:53.132	228.53	1.12	0.247	0.965	50.0
355	05:54.138	228.48	1.13	0.247	0.956	50.1
356	05:55.144	228.58	1.12	0.247	0.964	50.0
357	05:56.135	228.46	1.13	0.247	0.956	50.1
358	05:57.142	228.19	1.12	0.246	0.962	50.0
359	05:58.340	228.19	1.13	0.247	0.957	50.0
360	05:59.140	228.30	1.13	0.247	0.957	50.1
361	06:00.338	228.18	1.13	0.246	0.954	50.0
362	06:01.136	228.67	1.13	0.248	0.959	50.1
363	06:02.143	229.51	1.13	0.249	0.960	50.1
364	06:03.341	229.00	1.13	0.248	0.958	50.1
365	06:04.331	229.42	1.14	0.250	0.955	50.1
366	06:05.338	229.02	1.13	0.249	0.962	50.0
367	06:06.344	228.71	1.13	0.248	0.959	50.0
368	06:07.335	228.70	1.13	0.248	0.959	50.1
369	06:08.341	228.67	1.13	0.248	0.959	50.1
370	06:09.332	228.94	1.13	0.249	0.962	50.0
371	06:10.339	228.96	1.13	0.248	0.958	50.1
372	06:11.329	228.81	1.13	0.248	0.959	50.1
373	06:12.335	228.65	1.13	0.247	0.955	50.1
374	06:13.343	228.59	1.13	0.247	0.956	50.1
375	06:14.332	228.53	1.13	0.248	0.960	50.1
376	06:15.340	228.12	1.13	0.246	0.954	50.0
377	06:16.330	228.28	1.12	0.246	0.962	50.0
378	06:17.337	228.57	1.13	0.247	0.956	50.0
379	06:18.344	228.69	1.12	0.248	0.968	50.0
380	06:19.334	228.61	1.13	0.247	0.956	50.1
381	06:20.340	228.82	1.13	0.248	0.959	50.1
382	06:21.331	228.36	1.13	0.247	0.957	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
383	06:22.337	228.55	1.13	0.248	0.960	50.1
384	06:23.328	228.22	1.13	0.247	0.957	50.1
385	06:24.335	228.34	1.12	0.248	0.969	50.1
386	06:25.341	228.85	1.13	0.248	0.959	50.1
387	06:26.331	229.14	1.13	0.249	0.961	50.1
388	06:27.338	228.17	1.12	0.247	0.966	50.0
389	06:28.328	228.20	1.12	0.247	0.966	50.1
390	06:29.335	228.33	1.13	0.248	0.961	50.1
391	06:30.342	228.41	1.13	0.246	0.953	50.1
392	06:31.332	228.24	1.12	0.246	0.962	50.1
393	06:32.339	228.11	1.13	0.246	0.954	50.1
394	06:33.331	228.10	1.13	0.247	0.958	50.1
395	06:34.336	228.22	1.12	0.247	0.966	50.1
396	06:35.327	228.39	1.13	0.248	0.960	50.1
397	06:36.334	228.37	1.13	0.247	0.957	50.1
398	06:37.340	228.25	1.12	0.247	0.966	50.1
399	06:38.330	228.23	1.12	0.246	0.962	50.1
400	06:39.337	228.21	1.12	0.246	0.962	50.1
401	06:40.327	228.03	1.12	0.245	0.959	50.1
402	06:41.334	227.75	1.12	0.246	0.964	50.0
403	06:42.340	227.45	1.12	0.244	0.957	50.1
404	06:43.331	227.52	1.12	0.245	0.961	50.1
405	06:44.338	227.77	1.12	0.246	0.964	50.1
406	06:45.328	227.59	1.12	0.245	0.961	50.1
407	06:46.334	227.54	1.12	0.244	0.957	50.1
408	06:47.325	227.51	1.12	0.245	0.961	50.1
409	06:48.331	227.88	1.12	0.245	0.959	50.1
410	06:49.338	227.61	1.12	0.245	0.961	50.1
411	06:50.328	227.91	1.12	0.245	0.959	50.1
412	06:51.336	227.77	1.12	0.245	0.960	50.0
413	06:52.199	227.94	1.12	0.246	0.963	50.1
414	06:53.334	227.80	1.12	0.245	0.960	50.1
415	06:54.340	227.99	1.12	0.246	0.963	50.1
416	06:55.330	227.73	1.12	0.244	0.956	50.1
417	06:56.337	227.56	1.12	0.245	0.961	50.1
418	06:57.327	227.90	1.12	0.245	0.959	50.1
419	06:58.334	227.61	1.12	0.244	0.957	50.1
420	06:59.324	227.69	1.12	0.245	0.960	50.1
421	07:00.331	227.61	1.12	0.245	0.961	50.1
422	07:01.337	227.60	1.12	0.244	0.957	50.1
423	07:02.328	227.56	1.12	0.245	0.961	50.1



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
424	07:03.334	227.68	1.12	0.246	0.964	50.1
425	07:04.325	227.69	1.12	0.245	0.960	50.1
426	07:05.331	227.67	1.12	0.246	0.964	50.0
427	07:06.337	227.64	1.12	0.246	0.964	50.1
428	07:07.329	227.66	1.12	0.245	0.960	50.1
429	07:08.336	227.67	1.12	0.245	0.960	50.1
430	07:09.326	227.59	1.12	0.245	0.961	50.1
431	07:10.333	227.65	1.12	0.245	0.960	50.1
432	07:11.339	227.63	1.12	0.245	0.960	50.1
433	07:12.330	227.81	1.13	0.246	0.955	50.1
434	07:13.336	227.76	1.12	0.245	0.960	50.1
435	07:14.326	227.72	1.12	0.245	0.960	50.1
436	07:15.332	227.62	1.12	0.245	0.961	50.1
437	07:16.323	227.36	1.12	0.244	0.958	50.1
438	07:17.329	227.42	1.12	0.245	0.961	50.1
439	07:18.336	227.59	1.12	0.245	0.961	50.1
440	07:19.326	227.92	1.12	0.246	0.963	50.1
441	07:20.333	228.00	1.13	0.246	0.954	50.1
442	07:21.323	228.17	1.12	0.246	0.962	50.1
443	07:22.329	228.73	1.13	0.248	0.959	50.1
444	07:23.320	228.75	1.13	0.248	0.959	50.1
445	07:24.327	228.80	1.13	0.248	0.959	50.1
446	07:25.333	229.06	1.13	0.250	0.965	50.1
447	07:26.325	229.31	1.13	0.249	0.960	50.1
448	07:27.332	229.67	1.14	0.251	0.958	50.1
449	07:28.322	229.85	1.13	0.250	0.962	50.1
450	07:29.328	229.84	1.14	0.250	0.954	50.1
451	07:30.334	229.81	1.14	0.251	0.958	50.1
452	07:31.325	229.82	1.13	0.252	0.970	50.1
453	07:32.331	229.26	1.13	0.249	0.961	50.1
454	07:33.322	229.31	1.13	0.250	0.964	50.1
455	07:34.328	229.18	1.13	0.249	0.961	50.1
456	07:35.319	229.23	1.13	0.250	0.965	50.1
457	07:36.325	229.30	1.13	0.249	0.960	50.1
458	07:37.332	229.25	1.13	0.249	0.961	50.1
459	07:38.323	229.45	1.13	0.250	0.964	50.1
460	07:39.329	229.29	1.13	0.250	0.964	50.1
461	07:40.319	229.43	1.14	0.250	0.955	50.1
462	07:41.326	229.38	1.13	0.249	0.960	50.1
463	07:42.333	229.49	1.13	0.250	0.964	50.1
464	07:43.324	229.57	1.14	0.251	0.959	50.1



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
465	07:44.330	229.54	1.13	0.250	0.963	50.1
466	07:45.321	229.61	1.14	0.250	0.955	50.1
467	07:46.327	229.54	1.13	0.250	0.963	50.1
468	07:47.333	229.52	1.13	0.249	0.960	50.1
469	07:48.324	229.52	1.13	0.250	0.963	50.1
470	07:49.331	229.66	1.14	0.251	0.958	50.1
471	07:50.321	229.59	1.13	0.250	0.963	50.1
472	07:51.327	229.63	1.13	0.250	0.963	50.1
473	07:52.318	229.70	1.14	0.250	0.954	50.1
474	07:53.325	229.67	1.13	0.251	0.967	50.1
475	07:54.331	229.70	1.14	0.251	0.958	50.1
476	07:55.321	230.10	1.13	0.252	0.969	50.1
477	07:56.328	230.14	1.14	0.251	0.956	50.1
478	07:57.319	230.07	1.13	0.252	0.969	50.1
479	07:58.325	229.95	1.14	0.251	0.957	50.1
480	07:59.331	230.16	1.14	0.251	0.956	50.1
481	08:00.322	230.10	1.13	0.251	0.965	50.0
482	08:01.329	230.09	1.13	0.252	0.969	50.1
483	08:02.320	230.07	1.14	0.252	0.960	50.1
484	08:03.326	230.19	1.14	0.251	0.956	50.1
485	08:04.317	230.11	1.13	0.251	0.965	50.1
486	08:05.323	229.93	1.14	0.251	0.957	50.1
487	08:06.330	230.11	1.13	0.251	0.965	50.1
488	08:07.320	230.00	1.13	0.251	0.965	50.1
489	08:08.327	229.99	1.13	0.251	0.965	50.1
490	08:09.317	230.02	1.13	0.251	0.965	50.1
491	08:10.324	229.92	1.14	0.251	0.957	50.1
492	08:11.330	230.03	1.13	0.251	0.965	50.1
493	08:12.321	229.93	1.14	0.251	0.957	50.0
494	08:13.327	230.00	1.13	0.251	0.965	50.1
495	08:14.317	230.20	1.14	0.252	0.960	50.1
496	08:15.324	230.04	1.13	0.251	0.965	50.1
497	08:16.314	230.08	1.14	0.251	0.956	50.1
498	08:17.321	230.13	1.13	0.251	0.965	50.1
499	08:18.328	230.09	1.14	0.252	0.960	50.1
500	08:19.319	230.36	1.14	0.253	0.963	50.1
501	08:20.326	230.53	1.14	0.252	0.958	50.1
502	08:21.316	230.45	1.14	0.252	0.959	50.1
503	08:22.322	230.52	1.14	0.253	0.962	50.1
504	08:23.314	230.49	1.14	0.253	0.962	50.1
505	08:24.319	230.33	1.14	0.252	0.959	50.1



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
506	08:25.326	230.31	1.14	0.252	0.959	50.1
507	08:26.316	230.26	1.14	0.251	0.956	50.1
508	08:27.323	230.30	1.14	0.252	0.959	50.0
509	08:28.313	230.34	1.14	0.252	0.959	50.1
510	08:29.320	230.45	1.14	0.253	0.963	50.1
511	08:30.326	230.20	1.14	0.252	0.960	50.1
512	08:31.317	230.27	1.13	0.252	0.968	50.0
513	08:32.323	230.22	1.14	0.251	0.956	50.0
514	08:33.313	230.12	1.14	0.252	0.960	50.0
515	08:34.321	230.12	1.14	0.251	0.956	50.0
516	08:35.327	230.36	1.14	0.252	0.959	50.0
517	08:36.318	230.29	1.14	0.252	0.959	50.0
518	08:37.325	230.31	1.14	0.252	0.959	50.0
519	08:38.315	230.26	1.14	0.252	0.960	50.0
520	08:39.321	230.15	1.14	0.251	0.956	50.1
521	08:40.328	228.41	1.13	0.247	0.956	50.0
522	08:41.318	228.84	1.13	0.248	0.959	50.0
523	08:42.325	229.15	1.13	0.249	0.961	50.0
524	08:43.315	229.37	1.13	0.250	0.964	50.0
525	08:44.322	229.17	1.13	0.249	0.961	50.0
526	08:45.312	229.36	1.13	0.250	0.964	50.0
527	08:46.319	229.88	1.14	0.251	0.957	50.0
528	08:47.325	229.87	1.14	0.251	0.957	50.0
529	08:48.316	229.76	1.13	0.250	0.962	50.0
530	08:49.323	229.75	1.14	0.251	0.958	50.0
531	08:50.313	229.55	1.13	0.251	0.967	50.0
532	08:51.319	230.19	1.14	0.252	0.960	50.0
533	08:52.310	230.15	1.14	0.251	0.956	50.0
534	08:53.317	230.17	1.13	0.250	0.961	50.0
535	08:54.324	230.10	1.13	0.252	0.969	50.0
536	08:55.314	230.03	1.14	0.250	0.953	50.0
537	08:56.321	229.89	1.13	0.250	0.962	50.0
538	08:57.312	229.55	1.14	0.250	0.955	50.0
539	08:58.318	229.05	1.13	0.249	0.962	50.0
540	08:59.324	228.95	1.13	0.248	0.958	50.0
541	09:00.314	228.57	1.13	0.248	0.960	50.1
542	09:01.321	228.50	1.13	0.248	0.960	50.0
543	09:02.311	228.38	1.13	0.247	0.957	50.1
544	09:03.318	227.66	1.12	0.245	0.960	50.0
545	09:04.324	228.01	1.12	0.246	0.963	50.0
546	09:05.315	228.28	1.12	0.246	0.962	50.0



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
547	09:06.321	228.35	1.12	0.246	0.961	50.0
548	09:07.311	228.13	1.13	0.246	0.954	50.0
549	09:08.318	227.75	1.12	0.245	0.960	50.0
550	09:09.308	227.48	1.12	0.245	0.961	50.0
551	09:10.315	228.04	1.13	0.246	0.954	50.0
552	09:11.322	227.52	1.12	0.244	0.957	50.0
553	09:12.313	227.73	1.12	0.245	0.960	50.0
554	09:13.319	227.65	1.12	0.245	0.960	50.0
555	09:14.311	227.75	1.12	0.245	0.960	50.0
556	09:15.317	227.93	1.12	0.246	0.963	50.1
557	09:16.323	227.90	1.12	0.246	0.963	50.0
558	09:17.313	227.78	1.12	0.246	0.964	50.0
559	09:18.320	227.85	1.13	0.246	0.955	50.0
560	09:19.311	227.97	1.12	0.246	0.963	50.0
561	09:20.317	227.87	1.12	0.245	0.959	50.0
562	09:21.323	228.09	1.12	0.246	0.962	50.0
563	09:22.314	227.94	1.13	0.245	0.951	50.0
564	09:23.320	228.15	1.13	0.247	0.958	50.0
565	09:24.311	227.39	1.12	0.244	0.958	50.0
566	09:25.317	227.54	1.12	0.244	0.957	50.1
567	09:26.308	227.83	1.12	0.246	0.964	50.0
568	09:27.314	227.65	1.12	0.245	0.960	50.0
569	09:28.306	228.19	1.12	0.246	0.962	50.0
570	09:29.312	228.05	1.13	0.246	0.954	50.1
571	09:30.319	227.47	1.12	0.245	0.961	50.0
572	09:31.309	227.52	1.12	0.244	0.957	50.1
573	09:32.316	227.73	1.12	0.245	0.960	50.2
574	09:33.323	227.74	1.12	0.245	0.960	50.1
575	09:34.312	227.66	1.12	0.245	0.960	50.1
576	09:35.319	227.43	1.12	0.244	0.957	50.0
577	09:36.309	227.39	1.12	0.244	0.958	50.1
578	09:37.316	227.57	1.12	0.246	0.965	50.1
579	09:38.306	228.14	1.12	0.245	0.958	50.0
580	09:39.313	228.05	1.12	0.245	0.959	50.1
581	09:40.319	227.78	1.12	0.246	0.964	50.1
582	09:41.310	227.81	1.12	0.245	0.960	50.1
583	09:42.316	227.92	1.12	0.246	0.963	50.0
584	09:43.307	227.66	1.12	0.245	0.960	50.0
585	09:44.313	227.70	1.12	0.246	0.964	50.1
586	09:45.320	228.07	1.13	0.246	0.954	49.9
587	09:46.311	227.78	1.12	0.245	0.960	50.1



	Time	Voltage(V)	Current(mA)	Power(W)	Power factor(PF)	Frequency(Hz)
588	09:47.318	227.82	1.12	0.246	0.964	50.0
589	09:48.308	228.04	1.12	0.246	0.963	50.1
590	09:49.316	227.73	1.12	0.245	0.960	50.1
591	09:50.305	228.16	1.13	0.247	0.958	50.1
592	09:51.313	227.96	1.12	0.245	0.959	50.0
593	09:52.318	227.80	1.12	0.246	0.964	50.0
594	09:53.309	227.94	1.12	0.246	0.963	50.0
595	09:54.315	227.70	1.12	0.244	0.956	50.1
596	09:55.306	228.97	1.13	0.249	0.962	50.0
597	09:56.312	228.16	1.13	0.246	0.954	50.0
598	09:57.319	227.93	1.13	0.246	0.955	50.2
599	09:58.309	228.04	1.12	0.246	0.963	50.0
600	09:59.316	227.69	1.12	0.245	0.960	50.0